



# Elegance and precision engineering in the same breath.



HPL Electric & Power Limited a leading electrical equipment manufacturer with a strong innovative tradition, constantly striving for new level of excellence, developing innovative products and solutions. HPL Product range range which features high guality electronic energy meters, switchgears, lighting, wires & cables, as well as modular switches and accessories. With years of research and development Introducing our latest work of art.

The breathlessly gorgeous range,





1

**Osäfe** range the sculpted masterpiece of elegant design and precision engineering for overload safety





- Protection against Overload & Short Circuit.
- Widest Range 0.5A to 63 A.
- High Breaking Capacity 10KA
- With IP 20 Protection on Live Parts.
- With contact Position indicator
- Tested as Per IS/IEC 60898-1 : 2002 & 2003
- RCCB available 25A, 40A, 63 Amp, 80Amp in 30mA, 100mA, 300mA leakage tripping current.
- Tested as per IEC 610008-1, IS 12640-1





# Miniature Circuit Breakers 10kA

- Contact position indicator red / green
- Secure terminal connection
- 3-position DIN rail clip, permits removal from existing busbar system
- Comprehensive range of accessories suitable for subsequent installation
- Rated currents up to 63 A
- Tripping characteristics B, C, D
- Rated breaking capacity 10 kA
- Tested as per IS/IEC 60898-1 : 2002 & 2003
- IP20 degree of protection



# **Connection Diagrams**

| 1-pole | 1+N-pole | 2-pole | 3-pole | 3+N-pole | 4-pole  |
|--------|----------|--------|--------|----------|---------|
| 1      | 1 N      | 1 3    | 1 3 5  | 1 3 5 N  | 1 3 5 7 |
|        |          |        |        |          |         |
| 2      | 2 N      | 2 4    | 2 4 6  | 246 N    | 2 4 6 8 |

# Range



Osäfe



| <b>3 Position</b> | Mounting Clip             |
|-------------------|---------------------------|
| Permits install   | ation and removal without |
|                   | removing busbar.          |

# Design according to Osäfe : AC IS/IEC 60898-1 Osäfe : DC IS/IEC 60898-2 Breaking capacity Osäfe : AC Osäfe : AC 10kA (as per IS/IEC 60898-1) Characteristics B, C, D Rated Voltage Vac 240/415V

V<sub>DC</sub> 24V, 48V, 60V, 110V & 220V (Per pole)



# **Miniature Circuit Breakers 10kA**

- High selectivity between MCB and back-up device due to low let-through energy
- Compatible with standard busbar
- Busbar positioning optionally above or below
- Meets the requirements of insulation co-ordination, distance between contacts > 4 mm, for secure isolation
- Rated breaking capacity 10 kA Tested as per IS/IEC 60898-1: 2002.
- All range tested as per IEC 60898-1 : 2003.
- Tested at 16kA lcu as per IEC 60947-2, SPC 16A

|   | ACCESSORIES:                 | TECHNICAL<br>SPECIFICATIONS  | CODE               |
|---|------------------------------|--|--------------------|
| А | AUXILIARY<br>SWITCH*         | 6A<br>1NO+1NC  | OAUX61NO+1NC       |
| В | SHUNT TRIP<br>RELEASE*       | OPERATIONAL<br>VOLTAGE<br>a) 12-110-AC/12-60 VDC<br>b) 110-415V AC/110-220 VDC | OSTR24<br>OSTR240  |
| С | UNDER<br>VOLTAGE<br>RELEASE* | a) 240 V/WITHOUT DELAY<br>b) 415 V/WITHOUT DELAY                               | OUVR240<br>OUVR415 |


\*Under Development

# Technical Data Osäfe

| Electrical                                  |  |  |  |  |  |  |
|---|--|--|--|--|--|--|
| Design according to                         | IS/IEC 60898-1<br>IS/IEC 60898-2                             |  |  |  |  |  |
| Current test marks as printed on the device |  |  |  |  |  |  |
| Rated voltage                               | AC: 240/415V<br>DC: 24V, 48V, 60V, 110V & 220V<br>(per pole) |  |  |  |  |  |
| Rated frequency                             | 50 Hz  |  |  |  |  |  |
| Rated breaking capac                        | city according to IS/IEC 60898 10 kA                         |  |  |  |  |  |
| Characteristic                              | B, C, D  |  |  |  |  |  |
| Back-up fuse<br>Selectivity class           | max. 125 A gG<br>3   |  |  |  |  |  |
| Endurance                                   | 4000 operating cycles<br>On Load & Off Load                  |  |  |  |  |  |
| Terminal                                    | Un marked (Line/Load) reversable                             |  |  |  |  |  |

| Mechanical                |   |
|---------------------------|---|
| Frame size                | 45 mm   |
| Device height             | 80 mm   |
| Device width              | 17.5 mm per pole (1MU)  |
| Mounting                  | quick fastening with 3 lock-in positions on DIN rail EN 50022 |
| Degree of protection      | IP20  |
| Upper and lower terminals | open mouthed/lift terminals                                   |
| Terminal protection       | finger and hand touch safe,                                   |
| Terminal capacity         | 1-35 mm <sup>2</sup>  |
| (1p+N, 1.5MU)             | 1-35 mm <sup>2</sup> / 1-2x10 mm <sup>2</sup> (N)             |
| Terminal fastening torque | 2-2.4 Nm  |
| (1p+N, 1.5MU)             | 2-2.4 Nm / 1,2-1,5 Nm (N)                                     |
| Busbar thickness          | 0.8 - 2 mm  |
| Mounting                  | independent of position                                       |

# **Connection Diagrams**

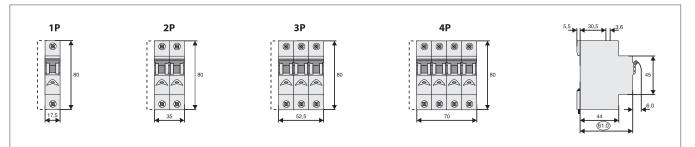

all dimension are in mm.

# DC MCB UPTO 63 AMPS

Osäfe MCB specially designed for DC application has been developed by HPL's world class R&D to meet the market's stringent requirements for DC circuits.


## **AVAILABILITY**

DC MCBs are available in SP & DP configuration from 0.5 Amp to 63 Amp in various voltages such as 12V, 24V, 48V, 60V, 110V, & 220V.

### **FEATURES**

- Dual tripping system-overload through precisely calibrated bimetal and short circuit through electromagnetic coil.
- DC MCB incorporates a built in permanent magnet, which directs the arc into the arc quenching chamber.
- Free from nuisance tripping caused by vibrations.
- Time constant < 5ms
- Housing of DC MCB is made up of fire retardant, anti-cracking and non-hygroscopic PBT/Nylon.
- Contacts are made up of silver inlaid copper, which ensure low resistance and longer life of circuit breaker.


# **Tripping Characteristics (IS/IEC 60898)**

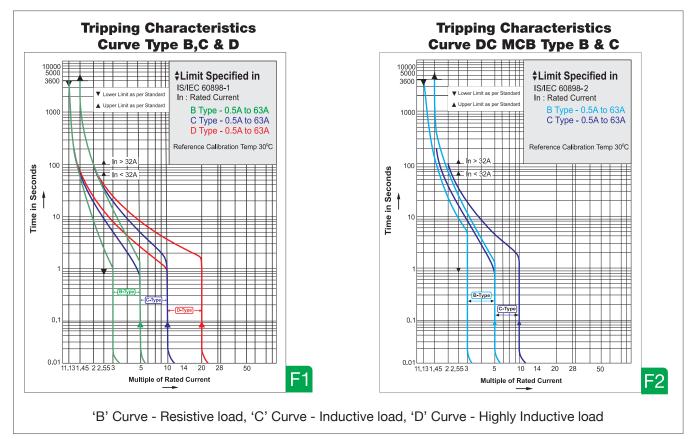





# **Effect of the Ambient Temperature on Thermal Tripping Behaviour** Adjusted rated current values according to the ambient temperature


|        | Ambient temperature T [°C] |      |      |      |      |      |      |      |      |      |      |      |     |
|--------|----------------------------|------|------|------|------|------|------|------|------|------|------|------|-----|
| In [A] | -25                        | -20  | -10  | 0    | 10   | 20   | 30   | 35   | 40   | 45   | 50   | 55   | 60  |
| 0.5    | 0.61                       | 0.60 | 0.58 | 0.56 | 0.54 | 0.52 | 0.50 | 0.49 | 0.48 | 0.47 | 0.46 | 0.45 | 0.4 |
| 1      | 1.2                        | 1.2  | 1.2  | 1.1  | 1.1  | 1.0  | 1.0  | 0.99 | 0.97 | 0.95 | 0.93 | 0.90 | 0.8 |
| 1.5    | 1.8                        | 1.8  | 1.7  | 1.7  | 1.6  | 1.6  | 1.5  | 1.5  | 1.5  | 1.4  | 1.4  | 1.4  | 1.: |
| 1.6    | 2.0                        | 1.9  | 1.9  | 1.8  | 1.7  | 1.7  | 1.6  | 1.6  | 1.5  | 1.5  | 1.5  | 1.4  | 1.4 |
| 2      | 2.4                        | 2.4  | 2.3  | 2.2  | 2.2  | 2.1  | 2.0  | 2.0  | 1.9  | 1.9  | 1.9  | 1.8  | 1.8 |
| 2.5    | 3.1                        | 3.0  | 2.9  | 2.8  | 2.7  | 2.6  | 2.5  | 2.5  | 2.4  | 2.4  | 2.3  | 2.3  | 2.  |
| 3      | 3.7                        | 3.6  | 3.5  | 3.4  | 3.3  | 3.1  | 3.0  | 3.0  | 2.9  | 2.8  | 2.8  | 2.7  | 2.  |
| 3.5    | 4.3                        | 4.2  | 4.1  | 3.9  | 3.8  | 3.7  | 3.5  | 3.4  | 3.4  | 3.3  | 3.2  | 3.2  | 3.  |
| 4      | 4.9                        | 4.8  | 4.7  | 4.5  | 4.3  | 4.2  | 4.0  | 3.9  | 3.9  | 3.8  | 3.7  | 3.6  | 3.  |
| 5      | 6.1                        | 6.0  | 5.8  | 5.6  | 5.4  | 5.2  | 5.0  | 4.9  | 4.8  | 4.7  | 4.6  | 4.5  | 4.  |
| 6      | 7.3                        | 7.2  | 7.0  | 6.7  | 6.5  | 6.3  | 6.0  | 5.9  | 5.8  | 5.7  | 5.6  | 5.4  | 5.  |
| 8      | 9.8                        | 9.6  | 9.3  | 9.0  | 8.7  | 8.4  | 8.0  | 7.9  | 7.7  | 7.6  | 7.4  | 7.2  | 7.  |
| 10     | 12                         | 12   | 12   | 11   | 11   | 10   | 10   | 9.9  | 9.7  | 9.5  | 9.3  | 9.0  | 8.  |
| 12     | 15                         | 14   | 14   | 13   | 13   | 13   | 12   | 12   | 12   | 11   | 11   | 11   | 11  |
| 13     | 16                         | 16   | 15   | 15   | 14   | 14   | 13   | 13   | 13   | 12   | 12   | 12   | 12  |
| 15     | 18                         | 18   | 17   | 17   | 16   | 16   | 15   | 15   | 15   | 14   | 14   | 14   | 1:  |
| 16     | 20                         | 19   | 19   | 18   | 17   | 17   | 16   | 16   | 15   | 15   | 15   | 14   | 14  |
| 20     | 24                         | 24   | 23   | 22   | 22   | 21   | 20   | 20   | 19   | 19   | 19   | 18   | 18  |
| 25     | 31                         | 30   | 29   | 28   | 27   | 26   | 25   | 25   | 24   | 24   | 23   | 23   | 22  |
| 32     | 39                         | 38   | 37   | 36   | 35   | 33   | 32   | 32   | 31   | 30   | 30   | 29   | 28  |
| 40     | 49                         | 48   | 47   | 45   | 43   | 42   | 40   | 39   | 39   | 38   | 37   | 36   | 35  |
| 50     | 61                         | 60   | 58   | 56   | 54   | 52   | 50   | 49   | 48   | 47   | 46   | 45   | 44  |
| 63     | 77                         | 76   | 73   | 71   | 68   | 66   | 63   | 62   | 61   | 60   | 58   | 57   | 56  |

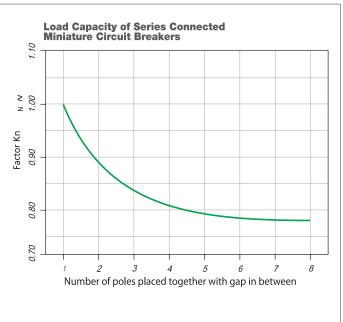

# Let-through Energy 10kA










Isolator




- Available in single break & double break
- Contact position indicator red / green
- Secure terminal connection
- 3-position DIN rail clip, permits removal from existing busbar system
- Comprehensive range of accessories suitable for subsequent installation
- Rated currents 40A 125A
- Rated conditional short circuit capacity 10 kA according to IS/IEC 60947-3
- IP20 degree of protection

# **Connection Diagrams Isolator**

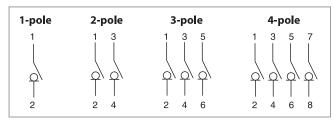

# **Single Break**

## **Dimensions (mm)**



all dimension are in mm.

### Mechanical

| Frame size                | 45 mm   |
|---------------------------|---|
| Device height             | 80 mm   |
| Device width              | 17.5 mm per pole (1MU)  |
| Mounting                  | quick fastening with 3 lock-in positions on DIN rail EN 50022 |
| Degree of protection      | IP20  |
| Upper and lower terminals | open mouthed/lift terminals                                   |
| Terminal protection       | finger and hand touch safe,                                   |
| Terminal capacity         | 1-35 mm <sup>2</sup>  |
| Terminal fastening torque | 2-2.4 Nm  |
| Busbar thickness          | 0.8 - 2 mm  |
| Mounting                  | independent of position                                       |
|                           |   |

### Electrical

| Reference Standard   | IS/IEC 60947-3                                     |
|--|--|
| No. of Poles   | 1P,2P,3P,4P  |
| Utilization Category   | AC 22B, AC 23B                                     |
| Rated Current (In)   | 40A, 63A, 80A, 100A, 125A                          |
| Rated Voltage (Ue)   | 240/415 V ~  |
| Rated Frequency (f)  | 50 Hz  |
| Rated Insulation Voltage (Ui)                                  | 660V   |
| Rated Impulse Voltage (Uimp)                                   | 6kV  |
| Dielectric Strength  | 2.5kV  |
| Electrical/Mechanical Endurance<br>(no. of operations) minimum | Electrical : 1500<br>Mechanical : 8500             |
| Humidity   | 95% RH   |
| Terminal Capacity (max)  | 35mm <sup>2</sup>                                  |
| Tightening Torque  | 2 N-m  |
| Vibration  | 3 g  |
| Shock Resistance   | 40mm free fall                                     |
| Protection Class   | IP20   |
| Positive Contact Indication                                    | Yes, Through Flag Indication<br>(Red-ON,Green-OFF) |
| Mounting   | Clip on DIN Rail<br>(35mm x 7.5mm)                 |
| Installation Position  | Vertical/Horizontal                                |
| Case & Cover   | Moulded, flame retardant<br>PBT/Nylon              |
| Busbar Connections Top Side                                    | Pin/Fork Type                                      |
| Busbar Connections Bottom Side                                 | Pin/Fork Type                                      |




# **MCB Changeover Switch**

- Conforms to IS/IEC : 60947-3
- Choice of Two Pole & Four Pole versions
- Front operation with three stable positions I-O-II
- Off at middle position
- DIN Rail Mounting facility



# **Connection Diagrams / Technical Marking**

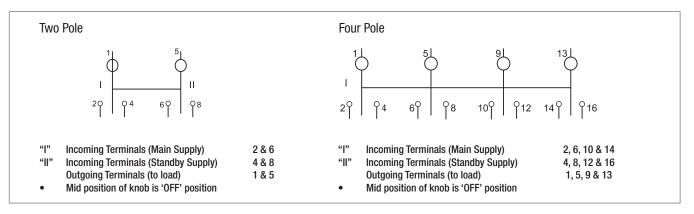


## Range







| Standard Conformity      |                 | : | IS/IEC 60947 - 3                  |
|--------------------------|-----------------|---|-----------------------------------|
| No. of Poles (Execution) |                 | : | 2 Pole, 4 Pole                    |
| Rated Current (In)       | А               | : | 25A, 40A, 63A                     |
| Rated Voltage (Ue)       | V               | : | 240 AC/415 AC                     |
| Rated Frequency          | Hz              | : | 50                                |
| Rated Insulation Voltage | V               | : | 660                               |
| Dielectric Strength      | kV              | : | 2.5                               |
| Rated Impulse Voltage    | kV              | : | 4                                 |
| Utilization Category     |                 | : | AC 22 A                           |
| Ambient Temp.            | °C              | : | -5 to +55                         |
| Mechanical Life          |                 | : | 10000 operations                  |
| Electrical Life          |                 | : | 1500 operations                   |
| Mounting                 |                 | : | Standard (35 x 7.5) mm - DIN Rail |
| Mounting Position        |                 | : | Vertical / Horizontal             |
| Terminal Capacity        | mm <sup>2</sup> | : | 35                                |
| Weight - Double Pole     | gms             | : | 134                               |
| Four Pole                | gms             | : | 268                               |

# Dimension (in mm)







4 Pole

# **Residual Current Circuit Breaker**

**Residual Current Circuit Breaker** 


- Tested as per IEC 61008-1, IS 12640-1,
- Dedicated Earth leakage protection.


 $\mathbf{i}$ 

- Short Circuit Withstand capacity 10 kA
- In Double Pole & Four Pole version
- Protection against Electrocution, Short Circuit & Electrical Fire.
- Range: 25 Amp, 40 Amp, 63Amp & 80 Amp in 30mA, 100mA & 300mA
- Consistent performance, Compact & Space Saving
- Wide variety of nominal current.
- Automatic re-setting possible.




# **Connection Diagrams**






# Range



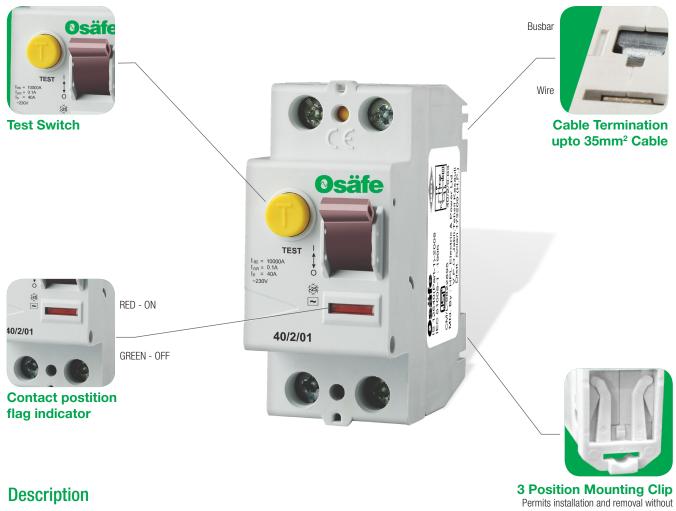

# Description

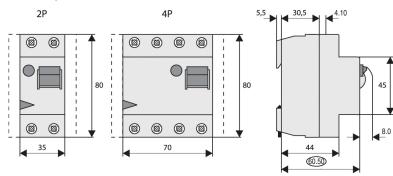

# **Electrical**

| Rated voltage                                     | 230 / 400V; 50 Hz                                   |
|---|---|
| Sensitivity/Rated<br>Leakage tripping current     | 30, 100, 300 mA                                     |
| Rated Conditional short<br>circuit strength       | 10kA with 63 A gG back-up fuse<br>10kA with 80 A gG |
| Maximum back-up fuse for short circuit protection | 63 A gG<br>80 A gG                                  |
| Maximum back-up fuse<br>for overload protection   | 25 A gG<br>40 A gG<br>50 A gG                       |
| Endurance electrical mechanical                   | > 4,000 operations                                  |

removing busbar.

# Residual Current Protection Unit

# **Residual Current Protection Unit**

- Add-on residual current unit
- Line voltage-independent tripping
- By combining this device with a miniature circuit breaker a top-quality RCBO unit (combined RCD/MCB device) is formed.
- Rated current 16 and 63 A
- Permits combinations with a variety of characteristics thanks to the different rated currents and characteristics of the miniature circuit breakers which can be connected
- Comrehensive range of accessories suitable for subsequent installation onto PLS.
- The test key "T" must be pressed every 6 month. The system operator must be informed of this obligation and his responsibility in a way that can be proven (self-adhesive RCD-label enclosed). The test intervall of 6 month is valid for residential and similar applications. Under all other conditions (e.g. damply or dusty environments), it's recommended to test in shorter intervalls (e.g. monthly).
- Pressing the test key "T" serves the only purpose of function testing the residual current device (RCD). This test does not make earthing resistance measurement (RE), or proper checking of the earth conductor condition redundant, which must be performed separately.
- **Type A :** Protect against special forms of residual pulsating DC which have not been smoothed.
- **Type G :** High reliability against unwanted tripping. Compulsory for any circuit where personal injury or damage to property may occur in case of unwanted tripping (ÖVE-EN1, Part1, §12.14).
- Type S: Selective residual current device, either sensitive to AC, type -S, or sensitive to pulsating DC, type -S/A, for protection against special forms of residual pulsating DC which have not been smoothed. Compulsory for systems with surge arresters downstream of the RCD (ÖVE-EN1, Part 1, §12.15).




### Accessories :

Cover cap for draw-out connection bar

Slotted one-way cheese head screw

### Accessories (on PLS.) : included Auxiliary switch for ZP-IHK subsequent installation ZP-WHK Tripping signal contact for ZP-NHK subsequent installation Remote control and automatic switching device Z-FW/LP Shunt trip release ZP-ASA/.. Z-USA/.. Undervoltage release KLV-TC-2 Compact enclosure KLV-TC-4 Z-HA-EK/35 Additional terminal 35mm2 Switching interlock IS/SPE-1TE


## **Connection Diagrams**



# **Technical Data**

| Electrical   |  | Mechanical                                 |   |  |
|--|--|--|---|--|
| Design according to  | IEC/EN 61009   | Frame-size                                 | 45 mm   |  |
| Current test marks as printed onto                                     |  | Device height                              | 90 mm   |  |
| the device   | instantaneous 250A   | Device width                               | 70 mm (2p), 107.5 mm<br>(3p),125 mm (4p)  |  |
| Tripping   | (8/20µs),surge<br>current-proof  | Mounting                                   | fix mounted onto PLS.   |  |
| Type G   | 10 ms delay 3kA (8/20µs),  | Degree of protection installed device      | IP20  |  |
|  | surge current-proof<br>40 ms delay 6kA - with  | Fastening screw                            | M 2.5 (slotted one-way cheese head screw;   |  |
| Type S   | selective disconnecting<br>function]   | Screw head breaking torque                 | > 0.6 Nm  |  |
| Rated voltage U <sub>n</sub>   | 230/400 V AC   | Upper and lower terminals                  | lift terminals  |  |
| Operational voltage range  | 196 - 440 V  |  | M 5 (combined<br>Philips/standard head<br>screws according to<br>DIN7962-Z2, Pozidrive) |  |
| Rated frequency  | 50 Hz  | Terminal screws                            |   |  |
| Use at 16 <sup>2/3</sup> Hz  | Recesses time between<br>the single switchings<br>increases to 88 s,                               | Terminal protection                        | finger and hand touch<br>safe, BGV A3, ÖVE-EN 6   |  |
|  | In max. 63A  | Terminal capacity                          |   |  |
| Use at 400 Hz  | I <sub>n</sub> max. 40 A   | Rigid conductors                           | 1 x (1 - 25) mm²  |  |
| Rated current I <sub>n</sub><br>Rated tripping current I <sub>An</sub> | ≤ 40 A, ≤ 63 A<br>30, 100, 300mA   | Flexible conductors (with wire end sleeve) | 1 x (0.75 - 16) mm²   |  |
| Rated non-tripping current I   | 0.5 I <sub>Δn</sub>  | Busbar thickness                           | 0.8 - 2 mm  |  |
| Sensitivity  | AC and pulsating DC  | Permitted ambient temperature              | -25°C to +40°C  |  |
| Service short circuit breaking capacity $I_{cs}$                       | same as connected<br>PLS. (7.5 kA)   |  | acc. to IEC/EN 60068-2  |  |
| Rated breaking capacity I <sub>cn</sub>                                | same as connected<br>PLS. (10 kA)  | Resistance to climatic conditions          | (2555°C/9095%<br>relative humidity)   |  |
| Rated fault breaking capacity l∆m                                      | $6 \text{ kA} (\text{U}_{\text{n}} = 230\text{V})3 \text{ kA} (\text{U}_{\text{n}} = 400\text{V})$ | Rated fault breaking capacity l∆m          | 6 kA (U <sub>n</sub> = 230V)3 kA<br>(U <sub>n</sub> = 400V)                             |  |

# **Connection Diagrams**

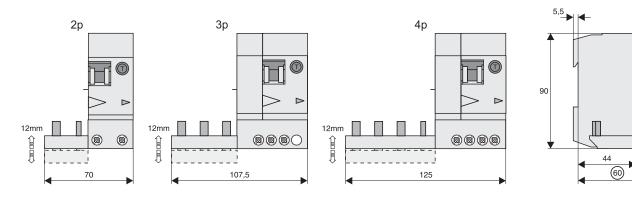

45

**9**,5

-

¥

# Osafe Combined RCD/MCB Devices

# Combined RCD/MCB Devices, 1+N-pole


- Combined RCD/MCB device
- Line voltage-independent tripping
- Compatible with standard busbar
- Twin-purpose terminal (lift/open-mouthed) above and below
- Busbar positioning optionally above or below
- Free terminal space despite installed busbar
- Guide for secure terminal connection
- Switching toggle (MCB component) in colour designating the rated current
- Contact position indicator red green
- Comprehensive range of accessories suitable for subsequent installation
- The test key "T" must be pressed every 6 month. The system operator must be informed of this obligation and his responsibility in a way that can be proven (self-adhesive RCD-label enclosed). The test intervall of 6 month is valid for residential and similar applications. Under all other conditions (e.g. damply or dusty environments), it's recommended to test in shorter intervalls (e.g. monthly).
- Pressing the test key "T" serves the only purpose of function testing the residual current device (RCD). This test does not make earthing resistance measurement (RE), or proper checking of the earth conductor condition redundant, which must be performed separately.
- **Type -A :** Protects against special forms of residual pulsating DC which have have not been smoothed
- **Type -G :** 10 ms time delay in order to avoid unwanted tripping (e.g. during thunderstorms).

Compulsory in Austria for any circuit where personal injury or damage to property may occur in case of unwanted tripping (§12.1.6 ÖVE/ÖNORM E 8001-1).



| Accessories:  |            |
|---|------------|
| Auxiliary switch for                                  | ZP-IHK     |
| subsequent installation                               | ZP-WHK     |
| Tripping signal switch for<br>subsequent installation | ZP-NHK     |
| Shunt trip release                                    | ZP-ASA/    |
| Tripping module                                       | Z-KAM      |
| Terminal cover cap                                    | KLV-TC-2   |
| Additional terminal 35mm2                             | Z-HA-EK/35 |
| Switching interlock                                   | IS/SPE-1TE |


# **Connection Diagrams**




# **Technical Data**

| Electrical  |  | Mechanical   |  |  |  |
|---|--|--|--|--|--|
| Design according to                                 | IEC/EN 61009   | Frame size   | 45 mm  |  |  |
| Current test marks as printed onto the device       |  | Device height                                      | 80 mm  |  |  |
|   |  | Device width                                       | 35 mm (2MU)  |  |  |
| Tripping line voltage-independent                   | instantaneous 250A<br>(8/20µs) surge<br>current-proof;       | Mounting   | 3-position DIN rail<br>clip,permits removal from<br>existing busbar system |  |  |
| Туре G  | 10 ms delay 3kA (8/20 <sub>µs</sub> )<br>surge current-proof | Upper and lower terminals                          | open mouthed/lift<br>terminals   |  |  |
| Rated voltage U <sub>e</sub>                        | 230 V; 50 Hz   |  |  |  |  |
| Operational voltage range                           | 196-253 V  | Terminal protection                                | finger and hand touch safe,BGV A3, ÖVE-EN 6                                |  |  |
| Rated tripping current $I_{\Delta n}$               | 30, 100, 300 mA  | Terminal capacity                                  | 1 - 25 mm²   |  |  |
| Rated non-tripping current l∆no                     | 0.5 I <sub>Δn</sub>  | Busbar thickness                                   | 0.8 - 2 mm   |  |  |
| Rated insulation voltage U <sub>i</sub>             | 440 VAC  | Degree of protection switch                        | IP20   |  |  |
| Sensitivity   | AC and pulsating DC  | Degree of protection, built-in                     | IP40   |  |  |
| Selectivity class                                   | 3  | Tripping temperature                               | -25°C to +40°C   |  |  |
| Rated breaking capacity                             | 10 kA  | Storage- and transport temperature                 | -35°C to +60°C   |  |  |
| Rated current                                       | 16 - 40 A  | Resistance to climatic conditions                  | acc. to IEC/EN 61009   |  |  |
| Rated peak withstand voltage ${\rm U}_{_{\rm imp}}$ | 4 kV (1.2/50 <sub>µs</sub> )                                 | Rated peak withstand voltage $U_{_{\mathrm{imp}}}$ | 4 kV (1.2/50 <sub>µs</sub> )   |  |  |
| Characteristic                                      | B, C   | Characteristic                                     | B, C   |  |  |
| Maximum back-up fuse (short circuit)                | 100 A gL (>10 kA)  | Maximum back-up fuse (short circuit)               | 100 A gL (>10 kA)  |  |  |
| Endurance electrical comp.                          | $\geq$ 4,000 operating cycles                                | Endurance electrical comp.                         | ≥ 4,000 operating cycles   |  |  |
| Mechanical comp.                                    | ≥ 20,000 operating cycles                                    | Mechanical comp.                                   | $\geq$ 20,000 operating cycles   |  |  |

# **Connection Diagrams**





# Combined RCD/MCB Devices




### Load Capacity -1N/

Effect of ambient temperature (MCB component)

|        |     | Ambient temperature T [°C] |      |     |     |     |     |     |     |  |  |  |  |  |
|--------|-----|----------------------------|------|-----|-----|-----|-----|-----|-----|--|--|--|--|--|
| In [A] | -25 | - 20                       | - 10 | 0   | 10  | 20  | 30  | 35  | 40  |  |  |  |  |  |
| 2      | 2.5 | 2.4                        | 2.3  | 2.2 | 2.2 | 2.1 | 2.0 | 2.0 | 1.9 |  |  |  |  |  |
| 4      | 4.9 | 4.8                        | 4.7  | 4.5 | 4.3 | 4.2 | 4.0 | 3.9 | 3.9 |  |  |  |  |  |
| 5      | 6.2 | 6.0                        | 5.8  | 5.6 | 5.4 | 5.2 | 5.0 | 4.9 | 4.8 |  |  |  |  |  |
| 6      | 7.4 | 7.2                        | 7.0  | 6.7 | 6.5 | 6.3 | 6.0 | 5.9 | 5.8 |  |  |  |  |  |
| 8      | 9.9 | 9.6                        | 9.3  | 9.0 | 8.7 | 8.4 | 8.0 | 7.9 | 7.7 |  |  |  |  |  |
| 10     | 12  | 12                         | 12   | 11  | 11  | 10  | 10  | 9.9 | 9.7 |  |  |  |  |  |
| 12     | 15  | 14                         | 14   | 13  | 13  | 13  | 12  | 12  | 12  |  |  |  |  |  |
| 13     | 16  | 16                         | 15   | 15  | 14  | 14  | 13  | 13  | 13  |  |  |  |  |  |
| 15     | 19  | 18                         | 17   | 17  | 16  | 16  | 15  | 15  | 15  |  |  |  |  |  |
| 16     | 20  | 19                         | 19   | 18  | 17  | 17  | 16  | 16  | 15  |  |  |  |  |  |
| 20     | 25  | 24                         | 23   | 22  | 22  | 21  | 20  | 20  | 19  |  |  |  |  |  |
| 25     | 31  | 30                         | 29   | 28  | 27  | 26  | 25  | 25  | 24  |  |  |  |  |  |
| 32     | 40  | 38                         | 37   | 36  | 35  | 33  | 32  | 32  | 31  |  |  |  |  |  |
| 40     | 49  | 48                         | 47   | 45  | 43  | 42  | 40  | 39  | 39  |  |  |  |  |  |

### Tripping Characteristic -1N/, Characteristics B & C

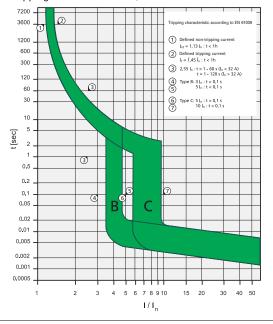

Short circuit selectivity characteristic C towards fuse link DII-DIV \*)

### Short Circuit Selectivity -1N/ towards DII-DIV fuse link

In case of short circuit, there is selectivity between the combined RCD/MCB devices 1N/ and the upstream fuses up to the specified values of the selectivity limit current  $l_s[kA]$  (i. e. in case of short-circuit currents  $l_k$  under  $l_s$ , only the MCB will trip, in case of short circuit currents above this value both protective devices will respond).

\*) basically in accordance with EN 60898-1 D.5.2.b

Short circuit selectivity characteristic B towards fuse link DII-DIV \*)

| Rating             | DII-DIV | gL/gG              |     |     |        |        |                    |        |                    | Rating             | DII-DI\             | / gL/gG             | i    |     |        |        |                    |                    |                    |
|--------------------|---------|--------------------|-----|-----|--------|--------|--------------------|--------|--------------------|--------------------|---------------------|---------------------|------|-----|--------|--------|--------------------|--------------------|--------------------|
| I <sub>n</sub> [A] | 10      | 16                 | 20  | 25  | 35     | 50     | 63                 | 80     | 100                | I <sub>n</sub> [A] | 10                  | 16                  | 20   | 25  | 35     | 50     | 63                 | 80                 | 100                |
| 2                  | < 0.51) | < 0.51)            | 2.2 | 8.5 | 10.02) | 10.02) | 10.02)             | 10.02) | 10.02)             | 2                  | < 0.51)             | < 0.51)             | 1.7  | 6.0 | 10.02) | 10.02) | 10.02)             | 10.02)             | 10.0 <sup>2)</sup> |
| 4                  | < 0.51) | < 0.51)            | 0.7 | 1.2 | 3.7    | 10.0   | 10.02)             | 10.02) | 10.02)             | 4                  | < 0.51)             | < 0.51)             | 0.7  | 1.3 | 4.2    | 8.5    | 10.02)             | 10.02)             | 10.0 <sup>2)</sup> |
| 6                  |         | <0.5 <sup>1)</sup> | 0.7 | 1.0 | 2.9    | 6.9    | 10.0 <sup>2)</sup> | 10.02) | 10.0 <sup>2)</sup> | 5                  | < 0.5 <sup>1)</sup> | < 0.5 <sup>1)</sup> | 0.6  | 1.1 | 3.6    | 7.0    | 10.0 <sup>2)</sup> | 10.0 <sup>2)</sup> | 10.0 <sup>2)</sup> |
| 8                  |         | <0.5 <sup>1)</sup> | 0.6 | 1.0 | 2.4    | 5.1    | 10.0 <sup>2)</sup> | 10.02) | 10.0 <sup>2)</sup> | 6                  |                     | < 0.5 <sup>1)</sup> | 0.6  | 1.0 | 2.9    | 5.8    | 10.0 <sup>2)</sup> | 10.0 <sup>2)</sup> | 10.0 <sup>2)</sup> |
| 10                 |         |                    | 0.6 | 0.9 | 1.9    | 3.3    | 7.0                | 10.02) | 10.0 <sup>2)</sup> | 8                  |                     | < 0.5 <sup>1)</sup> | <0.5 | 0.9 | 2.5    | 4.8    | 10.0 <sup>2)</sup> | 10.0 <sup>2)</sup> | 10.0 <sup>2)</sup> |
| 13                 |         |                    | 0.5 | 0.7 | 1.6    | 2.8    | 5.7                | 9.0    | 10.0 <sup>2)</sup> | 10                 |                     |                     | <0.5 | 0.7 | 1.5    | 2.6    | 5.3                | 9.0                | 10.0 <sup>2)</sup> |
| 16                 |         |                    |     | 0.7 | 1.4    | 2.4    | 4.4                | 7.0    | 10.02)             | 13                 |                     |                     |      |     | 1.4    | 2.3    | 4.6                | 7.6                | 10.02)             |
| 20                 |         |                    |     |     | 1.3    | 2.2    | 4.0                | 6.3    | 10.02)             | 16                 |                     |                     |      |     | 1.2    | 1.8    | 3.4                | 5.5                | 10.02)             |
| 25                 |         |                    |     |     | 1.3    | 2.1    | 3.8                | 5.8    | 10.0 <sup>2)</sup> | 20                 |                     |                     |      |     | 1.2    | 1.7    | 3.1                | 5.0                | 10.0 <sup>2)</sup> |
| 32                 |         |                    |     |     |        | 2.0    | 3.5                | 5.2    | 9.5                | 25                 |                     |                     |      |     |        | 1.6    | 2.9                | 4.6                | 10.0 <sup>2)</sup> |
| 40                 |         |                    |     |     |        |        | 3.1                | 4.5    | 8.1                | 32                 |                     |                     |      |     |        |        | 2.3                | 3.4                | 7.7                |
|                    |         |                    |     |     |        |        |                    |        |                    | 40                 |                     |                     |      |     |        |        |                    | 2.9                | 6.2                |

<sup>1)</sup> Selectivity limit current I<sub>s</sub> under 0.5 kA

 $^{2)}$  Selectivity limit current  $\rm I_s^{}=$  rated breaking capacity  $\rm I_{cn}$  of the RCD/MCB device Darker areas: no selectivity

# **Protective Devices**

### Short Circuit Selectivity-1N/ towards D01-D03 fuse link

In case of short circuit, there is selectivity between the combined RCD/MCB devices 1N/ and the upstream fuses up to the specified values of the selectivity limit current Is [kA] (i. e. in case of short-circuit currents Iks under Is, only the MCB will trip, in case of short circuit currents above this value both protective devices will respond).

\*) basically in accordance with EN 60898-1 D.5.2.b

Short circuit selectivity characteristic B towards fuse link D01-D03 \*) Short circuit selectivity characteristic C towards fuse link D01-D03 \*)

| Rating             | D01-D   | 03 gL/g | JG  |     |                    |                    |                   |                    |                    | Rating             | D01-D   | 03 gL/g            | gG      |     |                    |                    |                   |                    |      |
|--------------------|---------|---------|-----|-----|--------------------|--------------------|-------------------|--------------------|--------------------|--------------------|---------|--------------------|---------|-----|--------------------|--------------------|-------------------|--------------------|------|
| I <sub>n</sub> [A] | 10      | 16      | 20  | 25  | 35                 | 50                 | 63                | 80                 | 100                | I <sub>n</sub> [A] | 10      | 16                 | 20      | 25  | 35                 | 50                 | 63                | 80                 | 100  |
| 2                  | < 0.51) | 0.7     | 1.6 | 3.3 | 10.0 <sup>2)</sup> | 10.0 <sup>2)</sup> | 10.02             | 10.02)             | 10.0 <sup>2)</sup> | 2                  | < 0.51) | 0.5                | 0.5     | 2.4 | 10.0 <sup>2)</sup> | 10.0 <sup>2)</sup> | 10.02             | 10.0 <sup>2)</sup> | 10.0 |
| 4                  | < 0.51) | < 0.51) | 0.6 | 0.9 | 2.9                | 10.0               | 10.02             | 10.02)             | 10.0 <sup>2)</sup> | 4                  | < 0.51) | < 0.51)            | < 0.51) | 0.9 | 3.4                | 9.5                | 10.02             | 10.0 <sup>2)</sup> | 10.0 |
| 6                  |         | < 0.51) | 0.5 | 0.8 | 2.4                | 8.2                | 10.02             | 10.0 <sup>2)</sup> | 10.0 <sup>2)</sup> | 5                  | < 0.51) | < 0.51)            | < 0.51) | 0.9 | 2.9                | 8.0                | 10.02             | 10.0 <sup>2)</sup> | 10.0 |
| 8                  |         |         | 0.6 | 0.8 | 2.0                | 6.0                | 10.0 <sup>2</sup> | 10.0 <sup>2)</sup> | 10.0 <sup>2)</sup> | 6                  |         | <0.5 <sup>1)</sup> | < 0.51) | 0.8 | 2.3                | 6.5                | 10.0 <sup>2</sup> | 10.0 <sup>2)</sup> | 10.0 |
| 10                 |         |         | 0.5 | 0.8 | 1.6                | 3.7                | 6.0               | 10.0 <sup>2)</sup> | 10.0 <sup>2)</sup> | 8                  |         |                    | <0.5    | 0.7 | 2.1                | 5.5                | 9.5               | 10.0 <sup>2)</sup> | 10.0 |
| 13                 |         |         | 0.6 | 0.7 | 1.4                | 3.0                | 4.7               | 9.0                | 10.0 <sup>2)</sup> | 10                 |         |                    | <0.5    | 0.6 | 1.3                | 2.9                | 4.5               | 8.9                | 10.0 |
| 16                 |         |         |     | 0.6 | 1.2                | 2.6                | 3.9               | 7.0                | 10.0 <sup>2)</sup> | 13                 |         |                    |         |     | 1.2                | 2.5                | 3.9               | 7.6                | 10.0 |
| 20                 |         |         |     |     | 1.2                | 2.5                | 3.6               | 6.2                | 10.0 <sup>2)</sup> | 16                 |         |                    |         |     | 1.0                | 2.1                | 3.0               | 5.5                | 10.0 |
| 25                 |         |         |     |     | 1.2                | 2.3                | 3.3               | 5.7                | 10.0 <sup>2)</sup> | 20                 |         |                    |         |     | 1.0                | 2.0                | 2.7               | 5.0                | 10.0 |
| 32                 |         |         |     |     |                    | 2.3                | 3.1               | 5.1                | 10.0 <sup>2)</sup> | 25                 |         |                    |         |     |                    | 1.9                | 2.6               | 4.5                | 10.0 |
| 40                 |         |         |     |     |                    |                    | 2.8               | 4.5                | 9.5                | 32                 |         |                    |         |     |                    |                    | 2.1               | 3.4                | 10.0 |
|                    |         |         |     |     |                    |                    |                   |                    |                    | 40                 |         |                    |         |     |                    |                    |                   | 3.0                | 8.7  |

### Short Circuit Selectivity -1N/ towards NH-00 fuse link

In case of short circuit, there is selectivity between the combined RCD/MCB devices 1N/ and the upstream fuses up to the specified values of the selectivity limit current Is [kA] (i. e. in case of short-circuit currents Iks under Is, only the MCB will trip, in case of short circuit currents above this value both protective devices will respond).

\*) basically in accordance with EN 60898-1 D.5.2.b

Short circuit selectivity characteristic B towards fuse link NH-00 \*)

Short circuit selectivity characteristic C towards fuse link NH-00 \*)

| Rating             | NH                  | -00 g   | L/gG |                    |                    |                    |                    |                   |                    |                    |                   |                                 | Rating             | NH      | 1-0 |
|--------------------|---------------------|---------|------|--------------------|--------------------|--------------------|--------------------|-------------------|--------------------|--------------------|-------------------|---------------------------------|--------------------|---------|-----|
| I <sub>n</sub> [A] | 16                  | 20      | 25   | 32                 | 35                 | 40                 | 50                 | 63                | 80                 | 100                | 125               | 160                             | I <sub>n</sub> [A] | 16      | 20  |
| 2                  | < 0.51)             | 1.1     | 3.6  | 10.0 <sup>2)</sup> | 10.0 <sup>2)</sup> | 10.0 <sup>2)</sup> | 10.0 <sup>2)</sup> | 10.0 <sup>2</sup> | 10.0 <sup>2)</sup> | 10.0 <sup>2)</sup> | 10.0 <sup>2</sup> | <sup>)</sup> 10.0 <sup>2)</sup> | 2                  | < 0.51) | 0.  |
| 4                  | < 0.51)             | 0.5     | 0.9  | 1.6                | 2.8                | 4.4                | 10.0 <sup>2)</sup> | 10.0 <sup>2</sup> | 10.0 <sup>2)</sup> | 10.0 <sup>2)</sup> | 10.0 <sup>2</sup> | <sup>)</sup> 10.0 <sup>2)</sup> | 4                  | < 0.51) | <(  |
| 6                  | < 0.5 <sup>1)</sup> | 0.5     | 0.8  | 1.4                | 2.2                | 3.3                | 7.0                | 10.0 <sup>2</sup> | 10.0 <sup>2)</sup> | 10.0 <sup>2)</sup> | 10.0 <sup>2</sup> | <sup>)</sup> 10.0 <sup>2)</sup> | 5                  | < 0.51) | <(  |
| 8                  | < 0.51)             | < 0.51) | 0.7  | 1.0                | 1.9                | 2.8                | 5.3                | 7.8               | 10.0 <sup>2)</sup> | 10.0 <sup>2)</sup> | 10.0 <sup>2</sup> | <sup>)</sup> 10.0 <sup>2)</sup> | 6                  | < 0.51) | <(  |
| 10                 |                     | < 0.51) | 0.7  | 0.9                | 1.5                | 2.1                | 3.4                | 4.3               | 7.3                | 10.0 <sup>2)</sup> | 10.0 <sup>2</sup> | <sup>)</sup> 10.0 <sup>2)</sup> | 8                  | < 0.51) | <(  |
| 13                 |                     | < 0.51) | 0.6  | 0.8                | 1.4                | 1.8                | 2.8                | 3.6               | 5.7                | 10.0 <sup>2)</sup> | 10.0 <sup>2</sup> | <sup>)</sup> 10.0 <sup>2)</sup> | 10                 |         |     |
| 16                 |                     |         | 0.6  | 0.7                | 1.2                | 1.5                | 2.4                | 3.0               | 4.5                | 10.0 <sup>2)</sup> | 10.0 <sup>2</sup> | <sup>)</sup> 10.0 <sup>2)</sup> | 13                 |         |     |
| 20                 |                     |         |      | 0.7                | 1.1                | 1.5                | 2.2                | 2.8               | 4.2                | 9.2                | 10.0 <sup>2</sup> | <sup>)</sup> 10.0 <sup>2)</sup> | 16                 |         |     |
| 25                 |                     |         |      | 0.7                | 1.1                | 1.4                | 2.1                | 2.6               | 4.0                | 8.2                | 10.0 <sup>2</sup> | <sup>)</sup> 10.0 <sup>2)</sup> | 20                 |         |     |
| 32                 |                     |         |      |                    | 1.0                | 1.4                | 2.0                | 2.5               | 3.7                | 7.1                | 10.0 <sup>2</sup> | <sup>)</sup> 10.0 <sup>2)</sup> | 25                 |         |     |
| 40                 |                     |         |      |                    |                    |                    |                    | 2.3               | 3.4                | 6.2                | 8.8               | 10.0 <sup>2)</sup>              | 32                 |         |     |
|                    |                     |         |      |                    |                    |                    |                    |                   |                    |                    |                   |                                 | 40                 |         |     |

|                    | onoun               | 00.00   |      | onnan ao |                    |                    | toma               | us ius             | <i>, , , , , , , , , ,</i> |                   | 0 /                             |                    |
|--------------------|---------------------|---------|------|----------|--------------------|--------------------|--------------------|--------------------|----------------------------|-------------------|---------------------------------|--------------------|
| Rating             | NH                  | -00 g   | L/gG |          |                    |                    |                    |                    |                            |                   |                                 |                    |
| I <sub>n</sub> [A] | 16                  | 20      | 25   | 32       | 35                 | 40                 | 50                 | 63                 | 80                         | 100               | 125 1                           | 60                 |
| 2                  | < 0.51)             | 0.6     | 2.6  | 10.02)   | 10.0 <sup>2)</sup>         | 10.0 <sup>2</sup> | <sup>)</sup> 10.0 <sup>2)</sup> | 10.02)             |
| 4                  | < 0.51)             | < 0.51) | 0.9  | 1.8      | 3.2                | 4.8                | 8.7                | 10.0 <sup>2)</sup> | 10.0 <sup>2)</sup>         | 10.0 <sup>2</sup> | <sup>)</sup> 10.0 <sup>2)</sup> | 10.02)             |
| 5                  | < 0.5 <sup>1)</sup> | < 0.51) | 0.8  | 1.6      | 2.7                | 4.1                | 7.2                | 9.7                | 10.0 <sup>2)</sup>         | 10.0 <sup>2</sup> | <sup>)</sup> 10.0 <sup>2)</sup> | 10.0 <sup>2)</sup> |
| 6                  | < 0.51)             | < 0.51) | 0.7  | 1.3      | 2.2                | 3.3                | 5.9                | 8.0                | 10.0 <sup>2)</sup>         | 10.0 <sup>2</sup> | <sup>)</sup> 10.0 <sup>2)</sup> | 10.02)             |
| 8                  | < 0.51)             | < 0.51) | 0.6  | 1.1      | 1.9                | 2.8                | 5.0                | 6.7                | 10.0 <sup>2)</sup>         | 10.0 <sup>2</sup> | <sup>)</sup> 10.0 <sup>2)</sup> | 10.02)             |
| 10                 |                     |         | 0.5  | 0.8      | 1.2                | 1.7                | 2.7                | 3.4                | 5.5                        | 10.0 <sup>2</sup> | <sup>)</sup> 10.0 <sup>2)</sup> | 10.02)             |
| 13                 |                     |         |      |          | 1.1                | 1.5                | 2.3                | 2.9                | 4.7                        | 10.0 <sup>2</sup> | <sup>)</sup> 10.0 <sup>2)</sup> | 10.02)             |
| 16                 |                     |         |      |          | 1.0                | 1.3                | 1.8                | 2.3                | 3.7                        | 8.7               | 10.0 <sup>2)</sup>              | 10.0 <sup>2)</sup> |
| 20                 |                     |         |      |          | 0.9                | 1.1                | 1.7                | 2.2                | 3.4                        | 8.0               | 10.0 <sup>2)</sup>              | 10.0 <sup>2)</sup> |
| 25                 |                     |         |      |          |                    |                    | 1.6                | 2.1                | 3.2                        | 7.2               | 10.0 <sup>2)</sup>              | 10.0 <sup>2)</sup> |
| 32                 |                     |         |      |          |                    |                    |                    | 1.7                | 2.6                        | 5.3               | 9.0                             | 10.0 <sup>2)</sup> |
| 40                 |                     |         |      |          |                    |                    |                    |                    | 2.4                        | 4.5               | 7.5                             | 10.0               |

 $^{\rm 1)}$  Selectivity limit current  $\rm I_s$  under 0.5 kA

<sup>2)</sup> Selectivity limit current  $I_s$  = rated breaking capacity  $I_{cn}$  of the RCD/MCB device Darker areas: no selectivity

10.02) 10.02) 10.02) 10.02) 10.0<sup>2)</sup> 10.0<sup>2)</sup> 10.02) 10.02) 10.02) 10.02) 10.0<sup>2)</sup> 8.7

# **Distribution Board**

Wide Range-Varied Application

# Wide Range-Varied Application

Osäfe DB's are design to meet the requirement of today's Building Industry for domestic, commercial & Industrial application.

Osäfe DB's are aesthetically designed it cover all functionality & Safety norms to meets high standard of quality.

Our Distribution boards are manufactured with high precision & High Quality CRCA Steel Sheets. Its finest process of Phosphatizing ensure anti-rust conditioning with better finish.

Osäfe is available in elegant white colour. (RAL9003) Osäfe Distribution boards are as per IP 43 Protection with metal door.

Knockout for SPN & TPN DB's (26mm & 32mm).

Detachable Plate on Top and Bottom in case of higher conduits.




# Range







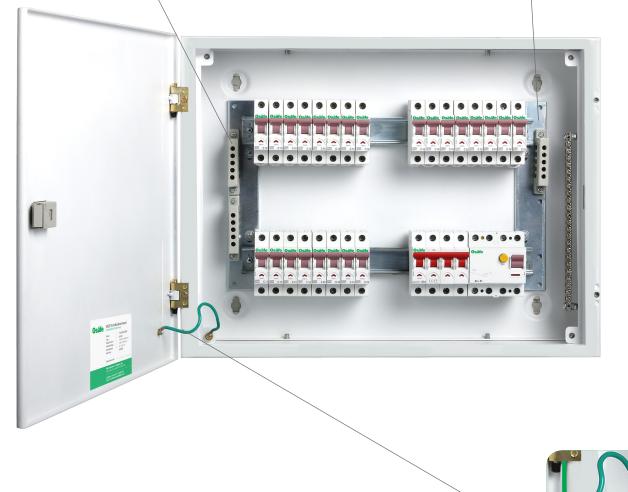

# **Major Features**

- Color white (RAL9003)
- As per IS 8623
- Cement Guard
- Anti Insertion Marker
- Shrouded neutral bar & insulated copper bus bar.
- Door Earthling
- Suitable for flash & Surface Mounting.
- As per IP-43 Protection

**Door Earthing** 

# **Distribution Board**


Wide Range-Varied Application




# **SPN DB Sailent Features**

- Suitable for flush mounting & surface mounting.
- Insulated Bus bar rated upto 200A.
- Safe Neutral link covered with FR Housing
- Door Earthing
- PAN Assembly for ease of installation.
- Special care of Cable Management
- Sunpack sheet
- Mat finish with new look & New Innovative DB







| Ways | Α      | В      | C      |  |  |
|------|--------|--------|--------|--|--|
| 4    | 220.00 | 226.00 | 196.00 |  |  |
| 6    | 255.00 | 226.00 | 231.00 |  |  |
| 8    | 290.00 | 226.00 | 266.00 |  |  |
| 10   | 325.00 | 226.00 | 301.00 |  |  |
| 12   | 360.00 | 226.00 | 336.00 |  |  |
| 14   | 395.00 | 226.00 | 371.00 |  |  |
| 16   | 430.00 | 226.00 | 406.00 |  |  |


# **TPN DB Sailent Features**


- Suitable for flush mounting & surface mounting.
- Insulated Bus bar rated upto 200A.
- Safe Neutral link covered with FR Housing
- Door Earthing
- Equipped with wire set
- Provision for FPMCB/Isolator & FP RCCB as Incommer
- PAN Assembly for ease of installation.
- Special care of Cable Management
- Sunpack sheet
- Mat finish with new look & New Innovative DB



# **Standard Accessories**

- Wire Set
- Insulated bus bar
- Insulated neutral bars & Earth Bar
- Blanking Plates
- Wire Management System
- Circuits identification Labels





| Ways | Α      | В      | С      |
|------|--------|--------|--------|
| 4    | 438.00 | 400.00 | 412.00 |
| 6    | 473.00 | 400.00 | 447.00 |
| 8    | 543.00 | 400.00 | 517.00 |
| 12   | 688.00 | 400.00 | 657.00 |

# HPL Global Presence





HPL Electric & Power Ltd Corp. Office : Windsor Business Park, B-1D, Sector-10, Noida, U.P. - 201301, INDIA Tel.: +91-120-4656300, Fax: +91-120-4656333 Registered Office : 1/20, Asaf Ali Road, New Delhi - 110 002, INDIA. E-mail : gsm@hplindia.com

www.hplindia.com